



9. SCHEMATIC DIAGRAM

9-1. MAIN SCHEMATIC DIAGRAM

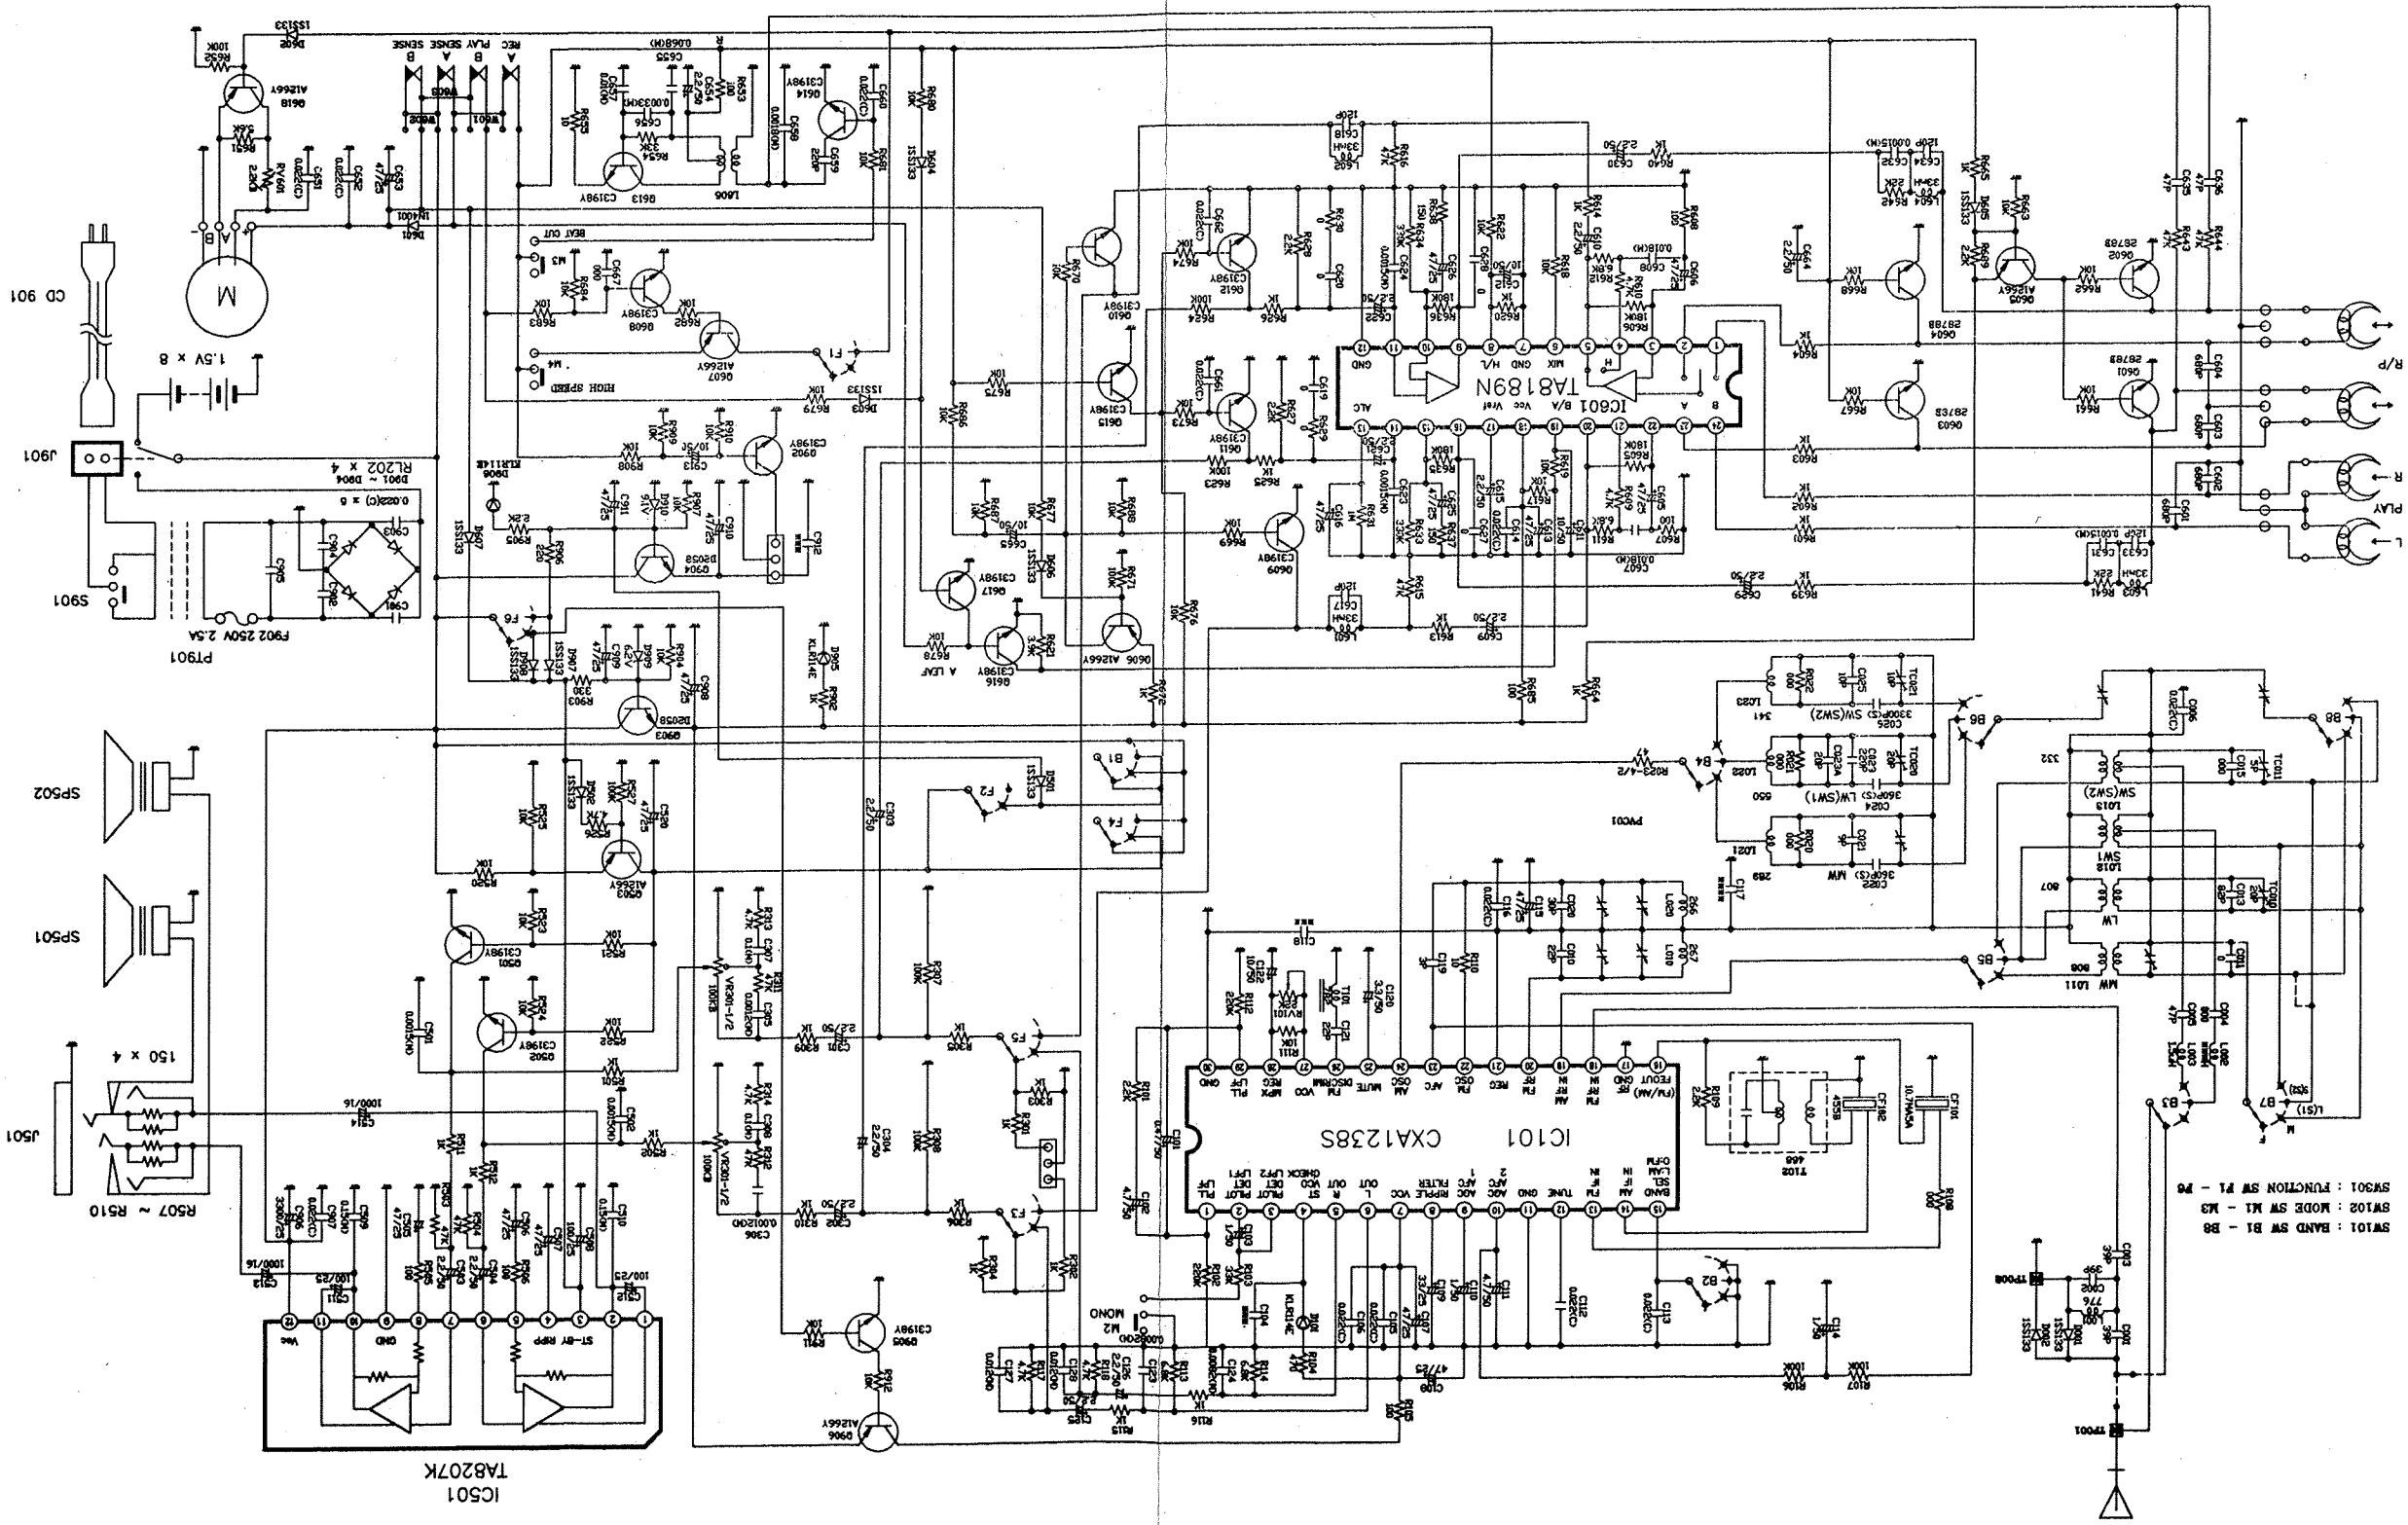

ACD-7500 SCHEMATIC DIAGRAM

9-2. CD SECTION

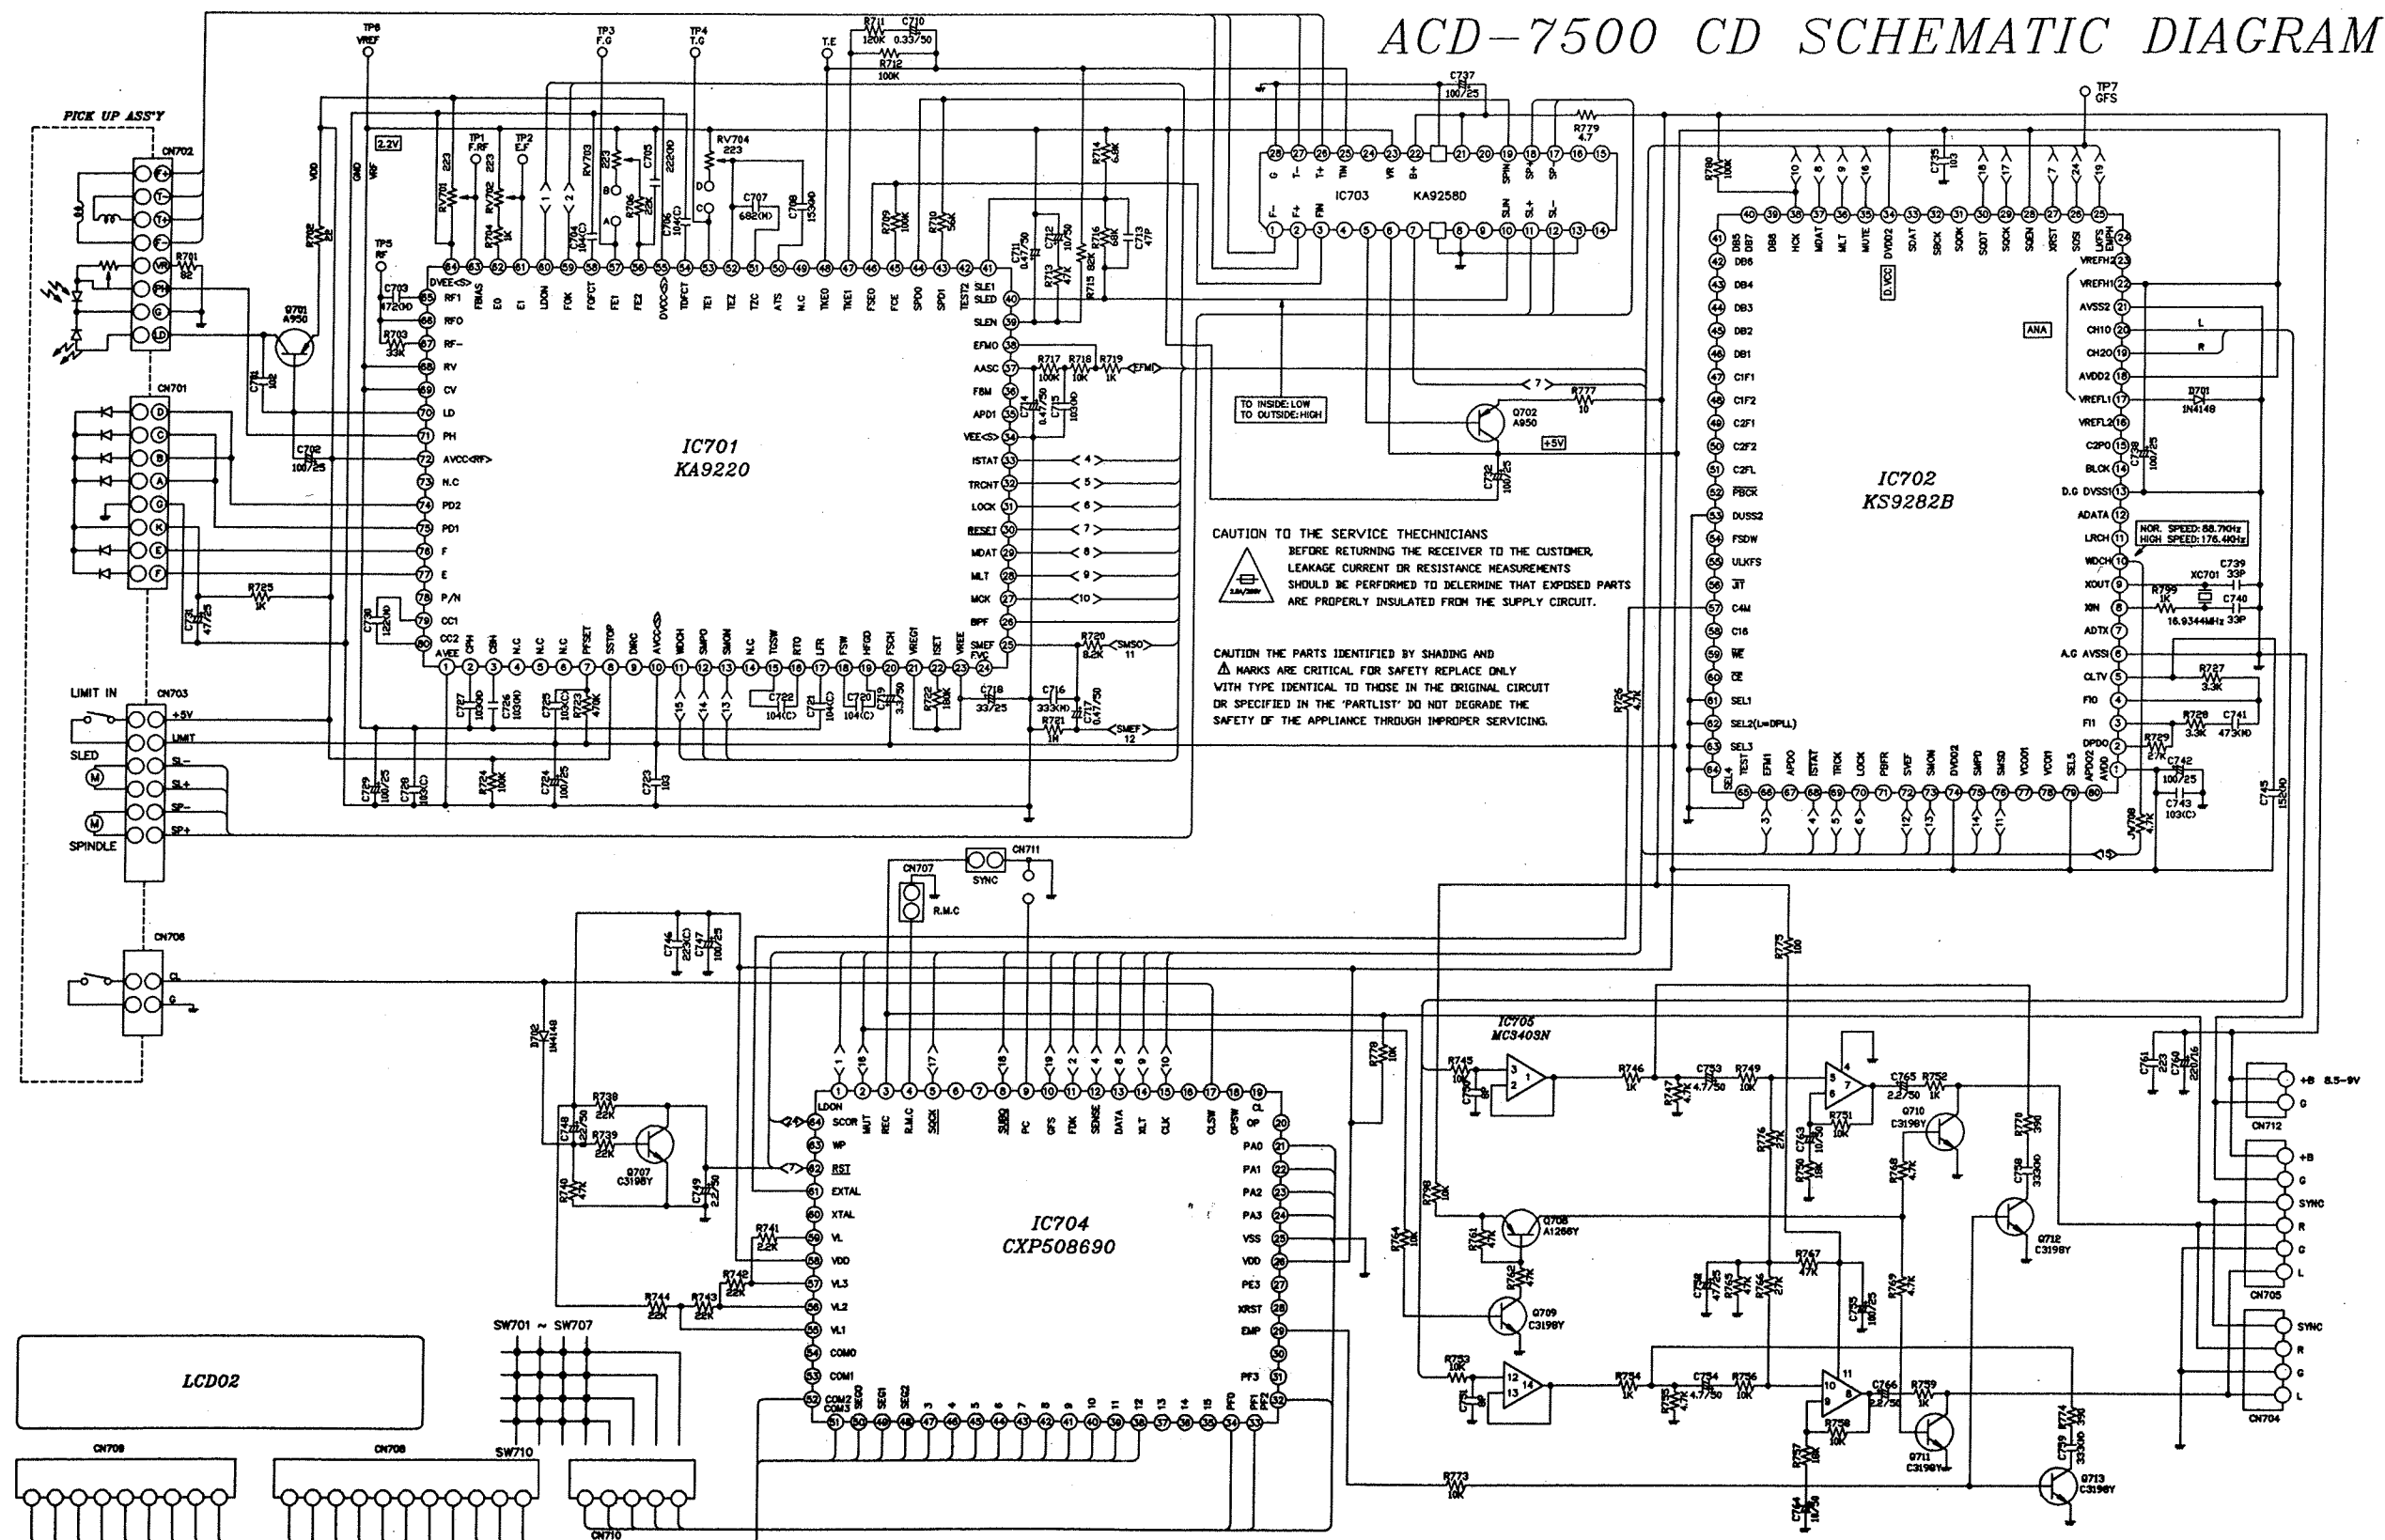


■ **SERVICING INSTRUCTIONS**

- 1) DISCONNECT THE SET FROM THE MAIN SUPPLY BEFORE OPENING THE CABINET.
- 2) COMPONENTS IDENTIFIED WITH THE SYMBOL ON THE SCHEMATIC DIAGRAM ARE NEEDED TO BE CRITICAL WITH RESPECT TO THE RISKS OF FIRE AND ELECTRICAL SHOCK ASSOCIATED WITH THE SET.
- 3) USE ONLY REPLACEMENT PARTS THAT HAVE THE CRITICAL CHARACTERISTICS RECOMMENDED BY THE MANUFACTURER.
- 4) SERVICE PERSONNEL SHALL MAKE LEAKAGE CURRENT OR RESISTANCE MEASUREMENTS TO DETERMINE THAT EXPOSED PARTS ARE ACCEPTABLY INSULATED FROM THE SUPPLY CURRENT BEFORE RETURNING THE APPARATUS TO THE CUSTOMER.

8. WIRING DIAGRAM

ACD-7500 WIRING DIAGRAM

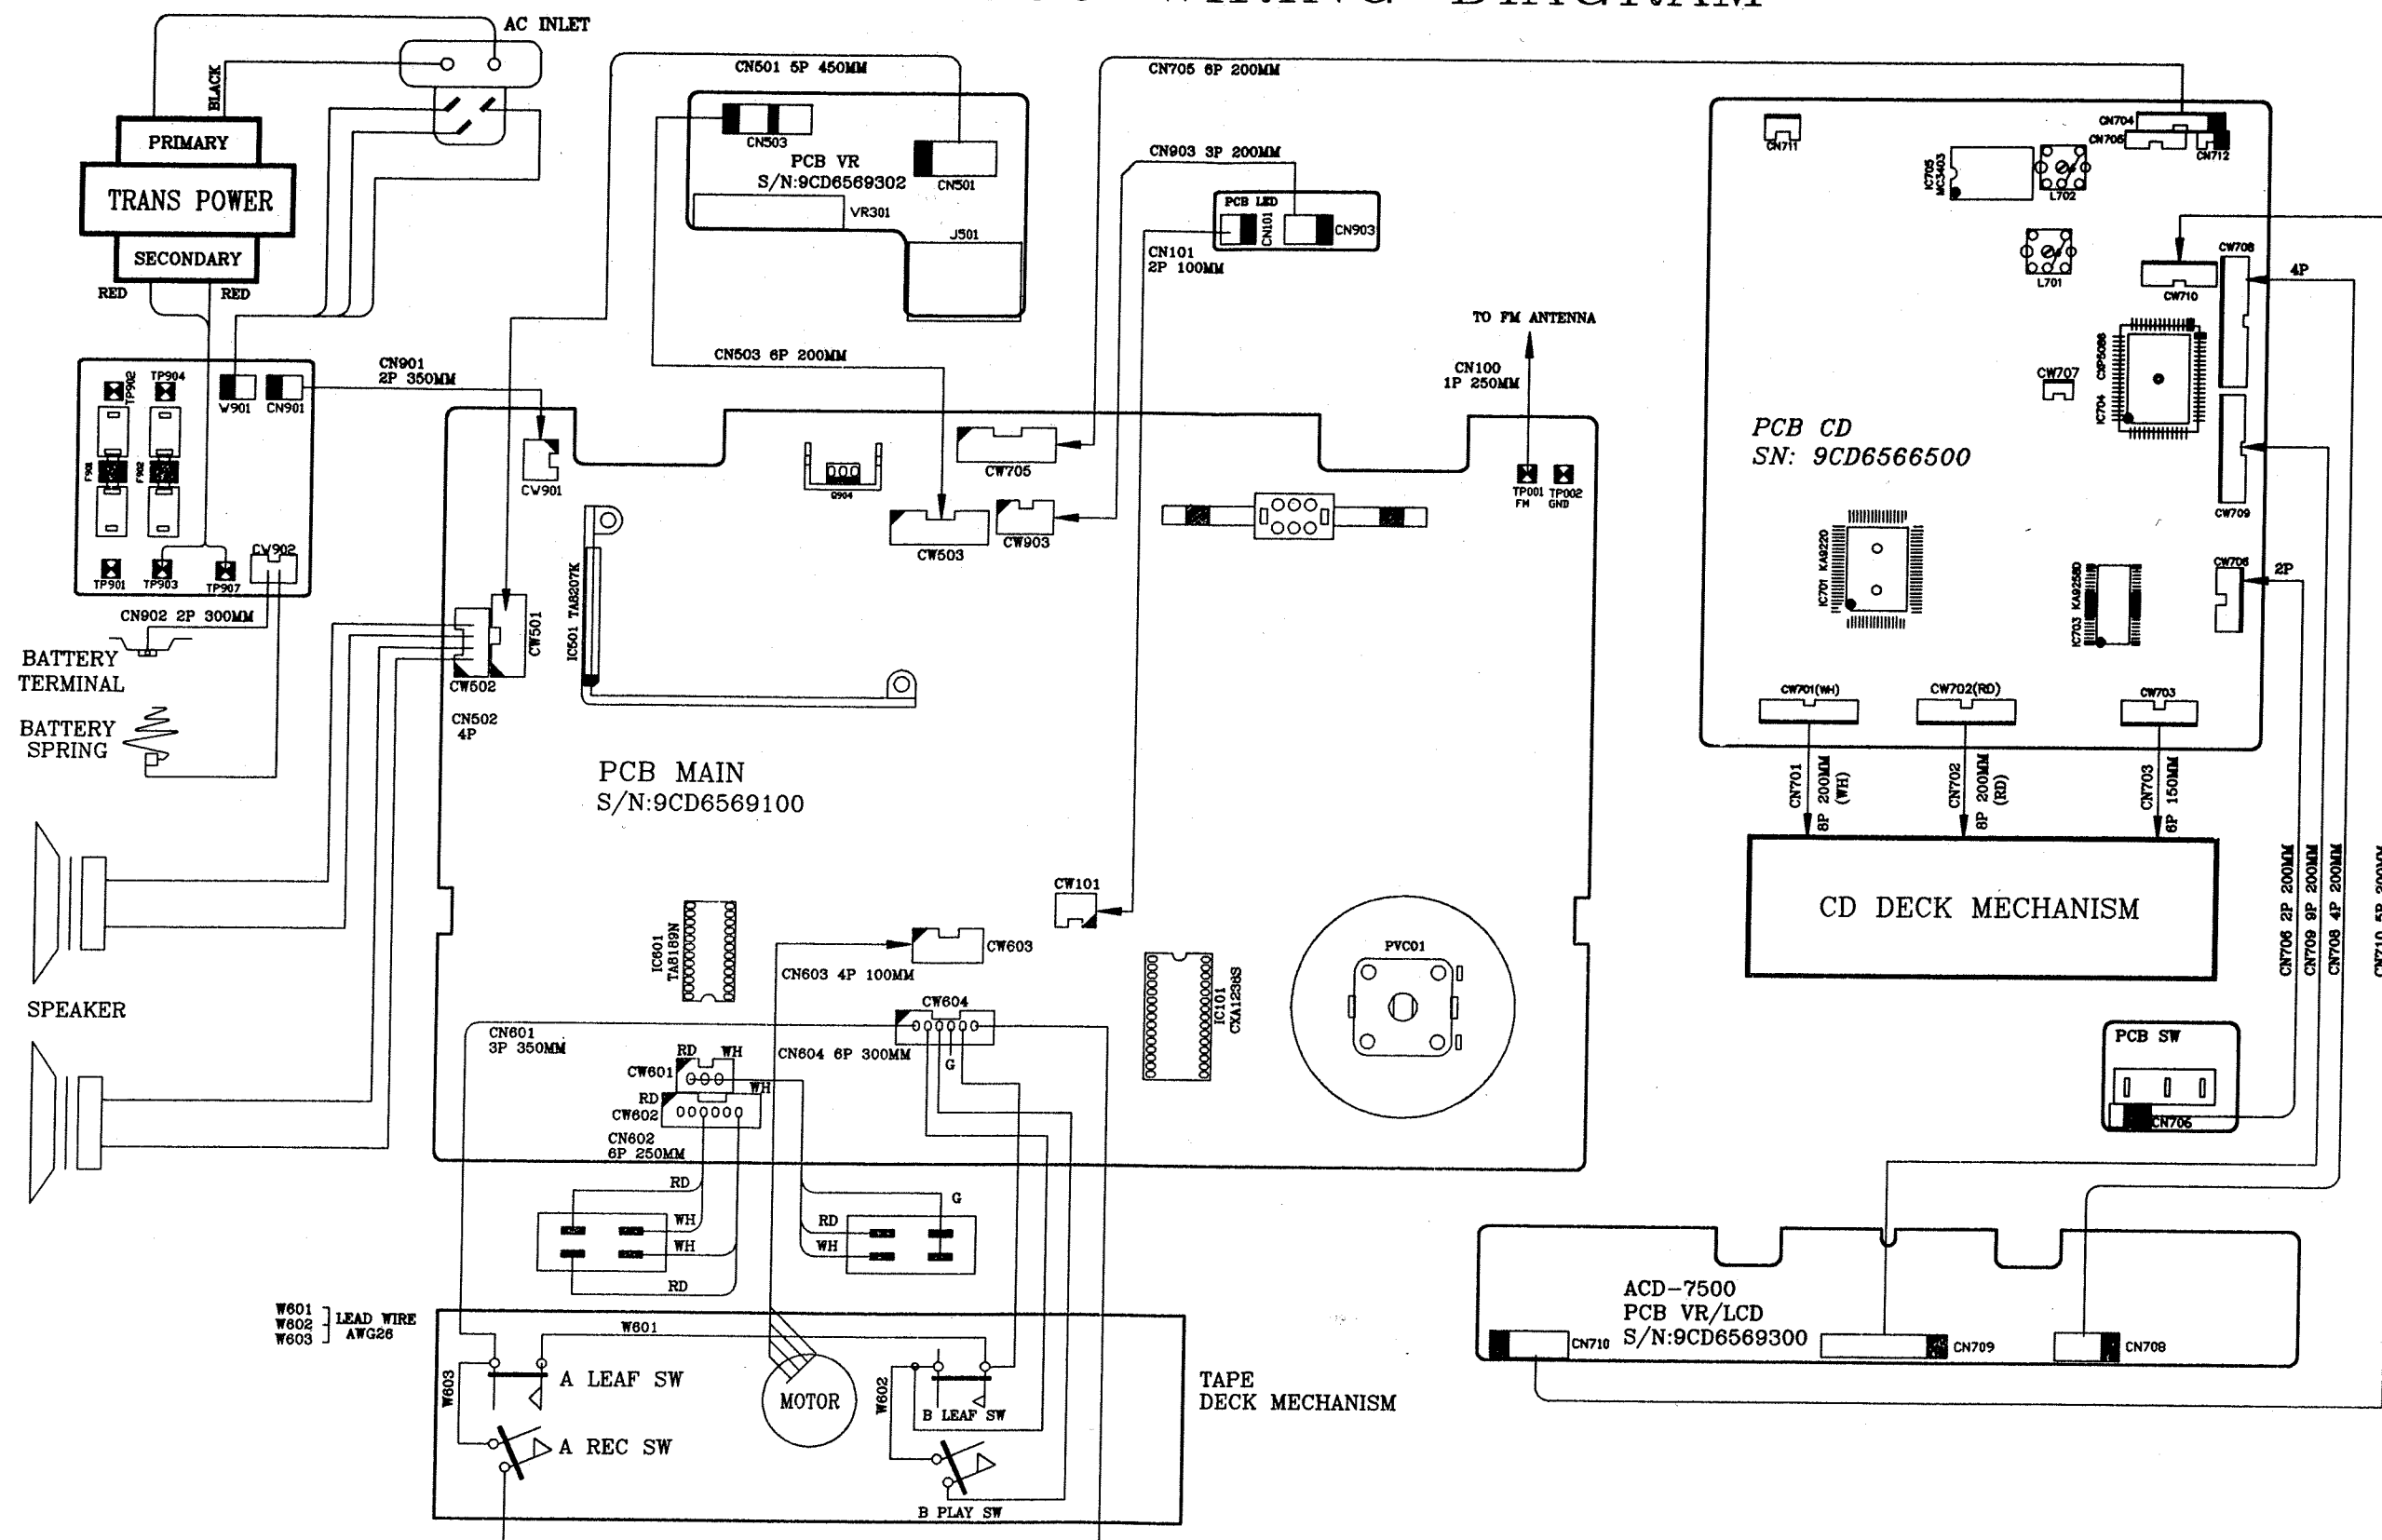

10. EXPLODED VIEW AND PART LIST

