


REVISION RECORD		
LTR	ECO NO.	APPROVED: DATE

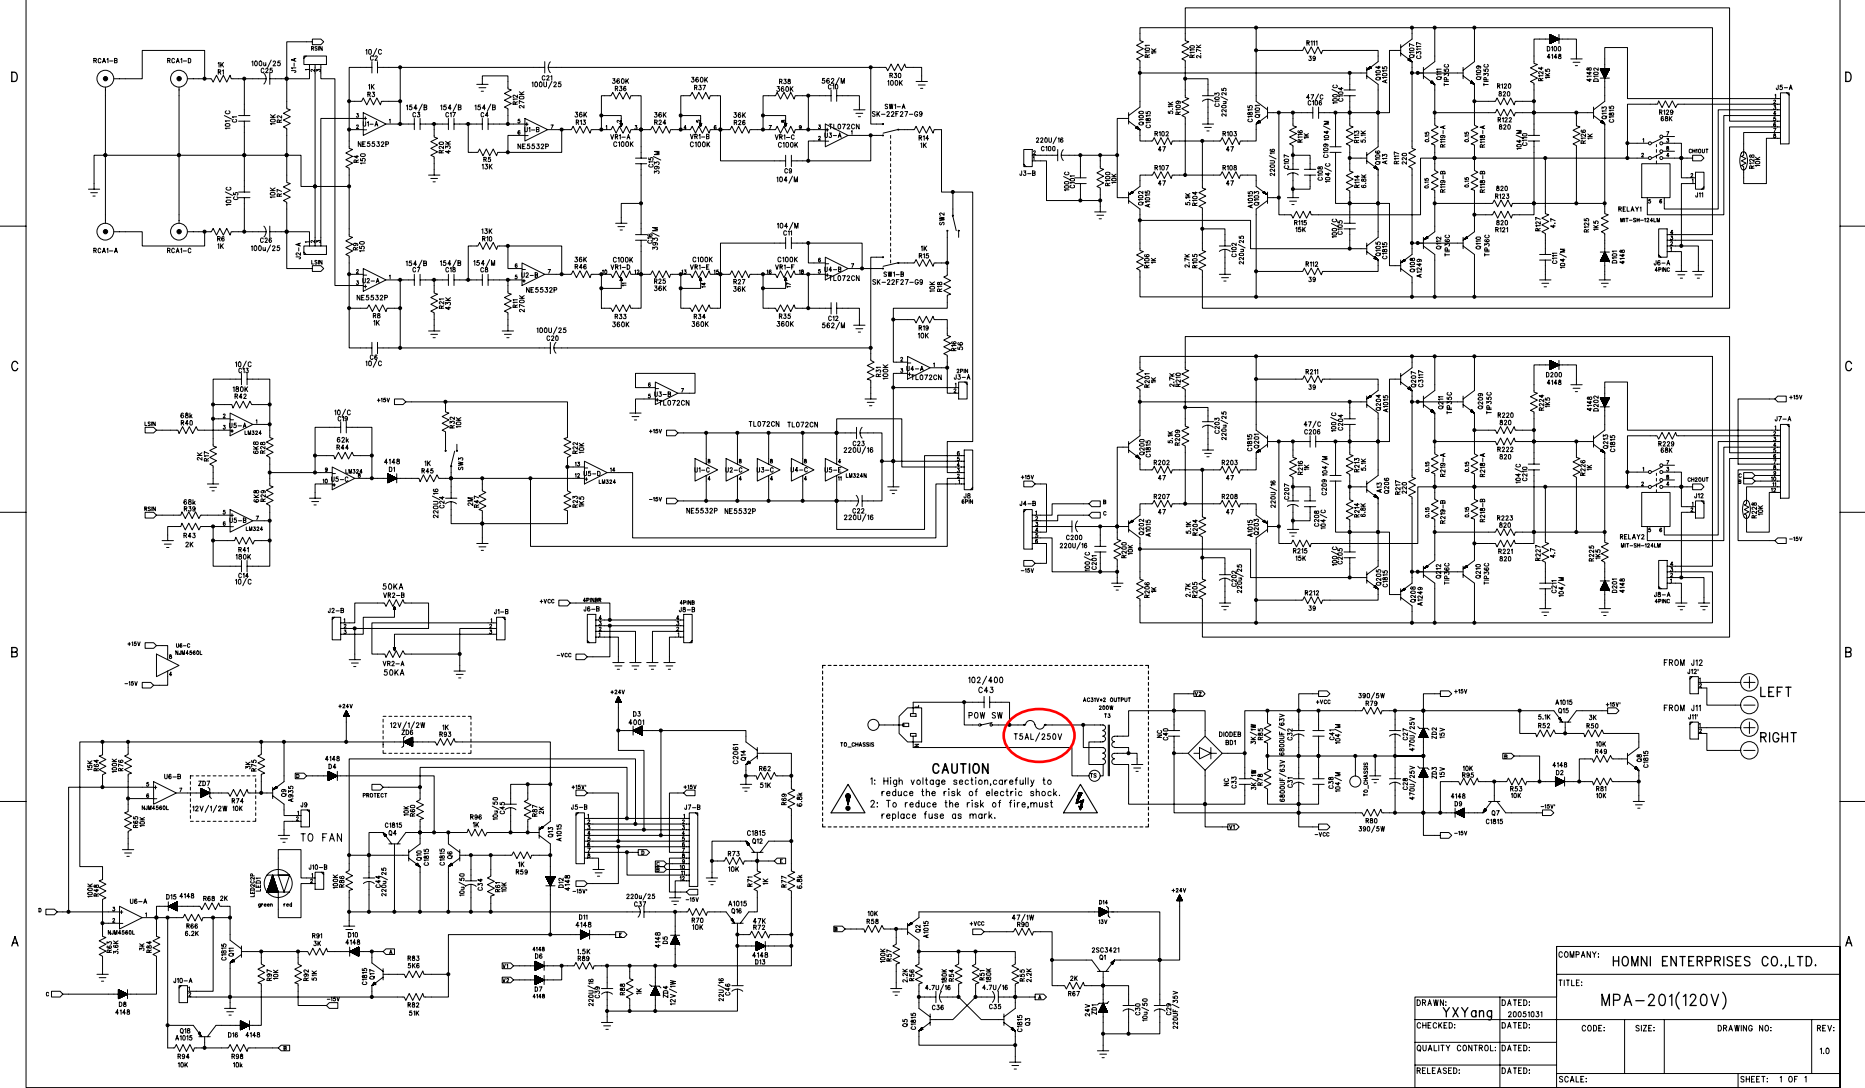

CAUTION
 1: High voltage section, carefully to reduce the risk of electric shock.
 2: To reduce the risk of fire, must replace fuse as mark.

COMPANY: HOMNI ENTERPRISES CO.,LTD.		TITLE: MPA-201(120V)	
DRAWN: XYang	DATED: 20051031	CODE:	SIZE:
CHECKED:	DATED:	DRAWING NO:	REV: 1.0
QUALITY CONTROL:	DATED:	SCALE:	SHEET: 1 OF 1
RELEASED:	DATED:		