
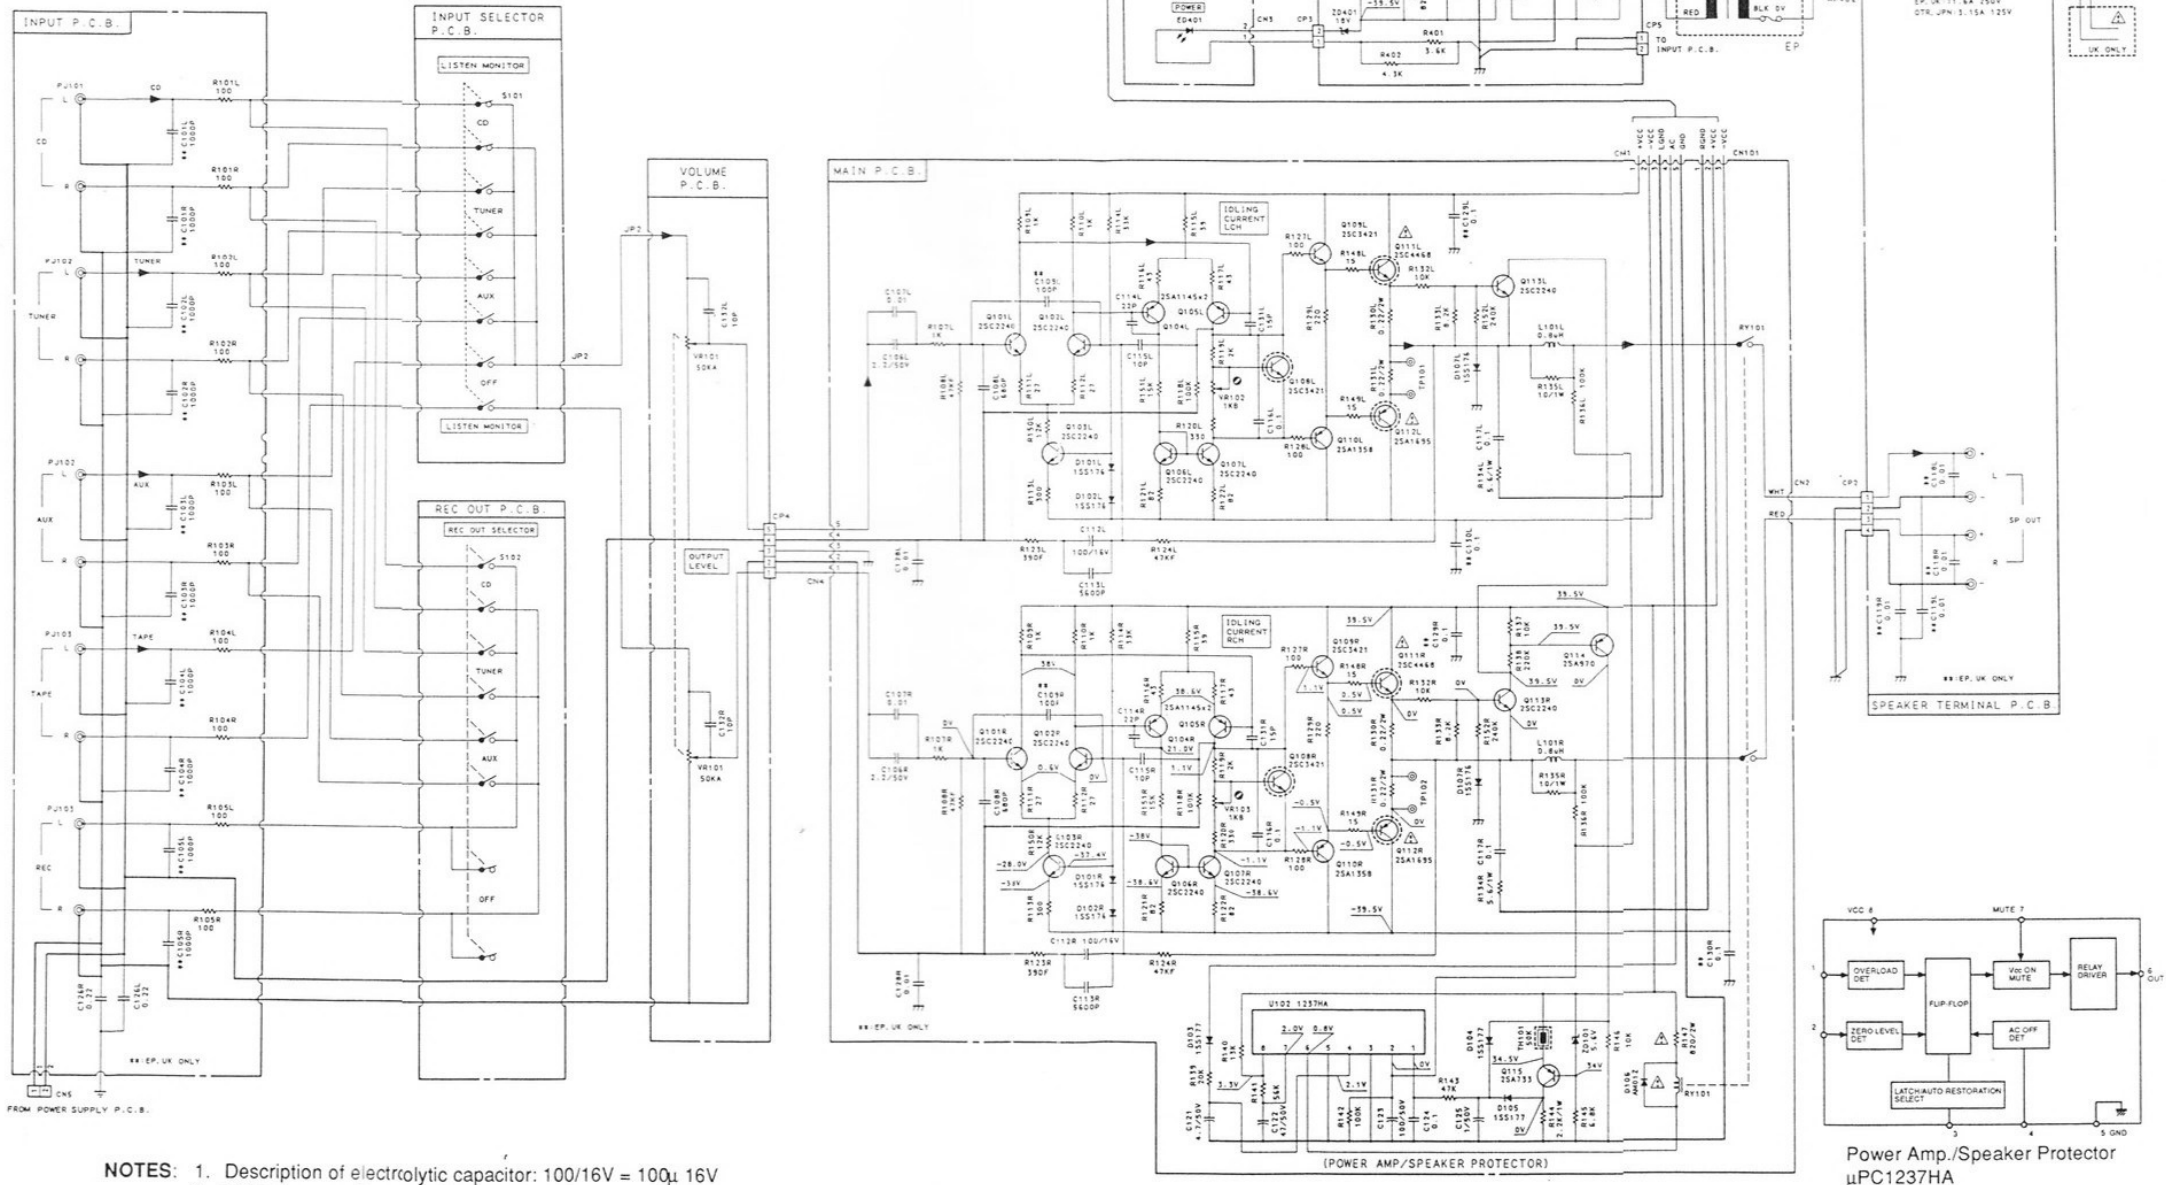


7. SCHEMATIC DIAGRAMS

7.1 For IA-3s

Parts marked with the symbol  in the schematic diagram have critical characteristics. Use ONLY replacement parts recommended by the manufacturer. It is recommended that the unit be operated from a suitable DC supply or batteries during initial check-out procedures.



- NOTES:**
1. Description of electrolytic capacitor: 100/16V = 100µ 16V
 2. Voltage measuring conditions
 - With no input signal applied to the input terminals.
 - With no load connected to the speaker terminals.

Fig. 7.1 For IA-3s